



Issued Date	ssued Date 6/28/2024		
Issued By	dschoeck	Issued Rev	

## **TYPICAL MOTOR PERFORMANCE DATA**

Model: 0014XPEC44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
1	0.75	4	1760	143TC	575	60	3	1.3
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	85.5	В		40 C

Load	HP	kW	Amperes	Efficiency (%)	Power Factor (%)
Full Load	1.00	0.7	1.3	85.6	69.8
¾ Load	0.75	0.6	1.1	83.8	61.5
½ Load	0.50	0.4	1.0	79.2	48.9
¼ Load	0.25	0.2	0.9	66.0	30.1
No Load			0.8		8.9
Locked Rotor			12.0		57.8

Torque					
Full Load	Locked Rotor	Pull Up	Break Down	Inertia	
(lb-ft)	(% FLT)	(% FLT)	(% FLT)	(lb-ft²)	
2.98	330	285	485	0.11	

Safe Stall	Time(s)	Sound	Bearin	Approx. Motor Weight	
Cold	Hot	Pressure	Bearings*		Approx. Motor Weight
Joid	1100	dB(A) @ 1M	DE	NDE	(lbs)
35	31	-	6305ZZC3	6305ZZC3	

\*Bearings are the only recommended spare part(s).

Motor Options: Product Family:EQP Global Explosion Proof Mounting:C-Face Round,Shaft:T Shaft

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.						
Engineering	jhock	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 0	
Engr. Date	6/11/2014	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011	




Issued Date	6/28/2024	Transmit #	
Issued By	dschoeck	Issued Rev	

# SPEED TORQUE/CURRENT CURVE

Model: 0014XPEC44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps	
1	0.75	4	1760	143TC	575	60	3	1.3	
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)	
TEFC	56	F	1.15	CONT	85.5	В		40 C	
Rotor wk <sup>2</sup>			Torque						
Locked Rotor Amps	Inertia	Full Load	Locked	Locked Rotor		Pull Up		Break Down	
Amps	(lb-ft²)	(lb-ft)	(%	b)	(%)		(%	<b>6</b> )	
12.0	0.11	2.98	33	330			48	35	

# Design Values

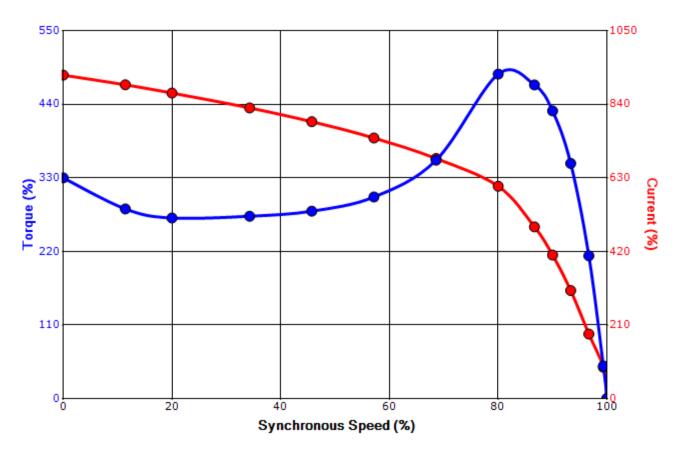




Customer	wk² Load Inertia (Ib-f	2) -
Customer PO	Load Typ	е -
Sales Order	Voltage (%	6) 100
Project #	Accel. Tim	е -


Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.							
Engineering	jhock	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1121 / 0		
Engr. Date	6/11/2014	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011		

# Motor Connection Diagram 3 Leads - Wye Connection Single Voltage

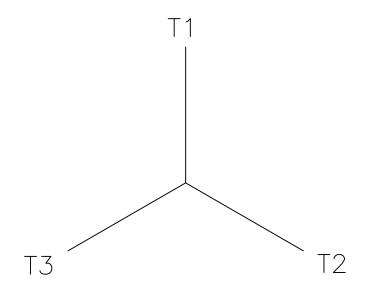



Switch L1 and L2 to reverse rotation

Each lead may consist of more than one cable. If multiple cables represent a single lead, each one of them will be labeled with the appropriate lead number.

By: R. Murillo Date: 4/9/08 Checked: Date: Revision 0



Issued Date:	6/28/2024	Transmit #:	
Issued By:	dschoeck	Issued Rev:	

## **SPARE PARTS LIST\***

Model: 0014XPEC44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
1	0.75	4	1760	143TC	575	60	3	1.3
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	85.5	В		40 C

 Bearings DE
 6305ZZC3 / 25BC03JPP3OA

 Bearings NDE
 6305ZZC3 / 25BC03JPP3OA

\*Bearings are the only recommended spare part(s).

Other than the grease used for regreasable bearings and the oil used for oil-lubricated bearings, Toshiba advises that there are no "use" parts. The only insurance spares that Toshiba suggests for these squirrel-cage induction motors are industry-standard and commercially available off-the-shelf bearings as noted above.

Motor components such as terminal boxes, fan covers and other machined parts are available on special request. In these cases, please advise our order entry department of the model and serial numbers found on the motor nameplate and a description of the needed components. With this information they will be able to furnish the current part number, price and availability.

Note: Our internal part numbers are subject to change without notice and are not published.

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.										
Engineering	jhock	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1125 / 0					
Engr. Date	6/11/2014	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011					