



Issued Date	9/24/2019	Transmit #	
Issued By	dschoeck	Issued Rev	

## **TYPICAL MOTOR PERFORMANCE DATA**

Model: Y756SDGR41A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	6	1170	254T	230/460	60	3	19.7/9.9
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	91	В	Н	40 C

Load	HP	kW	Amperes	Efficiency (%)	Power Factor (%)
Full Load	7.50	5.6	9.8	90.8	78.4
¾ Load	5.63	4.2	8.0	90.3	72.3
½ Load	3.75	2.8	6.5	88.3	60.6
¼ Load	1.88	1.4	5.5	80.6	39.1
No Load			4.6		5.7
Locked Rotor			63		47.1

Torque							
Full Load	Locked Rotor	Pull Up	Break Down	Inertia			
(lb-ft)	(% FLT)	(% FLT)	(% FLT)	(lb-ft²)			
33.7	255	240	315	2.16			

Safe Stall	Time(s)	Sound	Bearin	Approx. Motor Weight	
Cold	Hot	Pressure			
		dB(A) @ 1M	DE	NDE	(Ibs)
35	15	-	6309ZZC3	6309ZZC3	

\*Bearings are the only recommended spare part(s).

Motor Options:
Product Family:EQP Global Cooling Tower
Mounting:Footed,Shaft:T Shaft

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.										
Engineering	bmammen	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 1					
Engr. Date	6/5/2017	Doc. Approved By	M. Campbell	Doc. Issued	9/20/2019					




Issued Date	9/24/2019	Transmit #	
Issued By	dschoeck	Issued Rev	

#### SPEED TORQUE/CURRENT CURVE

Model: Y756SDGR41A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	6	1170	254T	230/460	60	3	19.7/9.9
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	91	В	Н	40 C
Laskad Datas	Rotor wk²	_			Torque			
Locked Rotor Amps	Inertia	Full Load	Locked	l Rotor	Pull U	р	Break Down	
Allips	(lb-ft²)	(lb-ft)	(%	6)	(%)		(%)	
63	2.16	33.7	255 240		3	15		

# Design Values

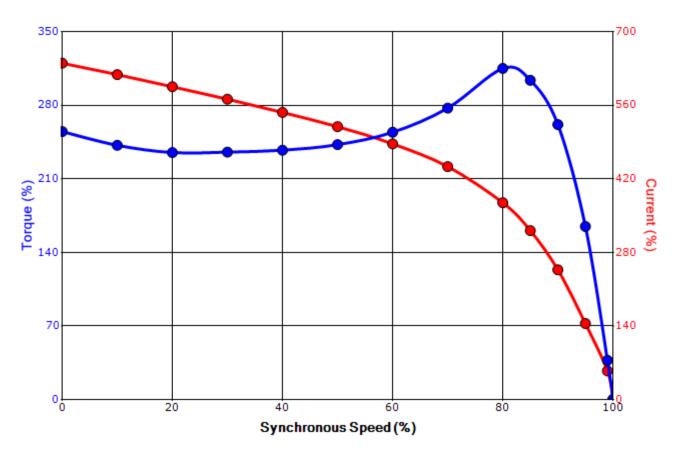



Customer	wk² Load Inertia (lb-ft²)	-
Customer PO	Load Type	1
Sales Order	Voltage (%)	100
Project #	Accel. Time	-
Tag:	 	

All	charac	teristics	are	average	expec	ted	val	ues.
-----	--------	-----------	-----	---------	-------	-----	-----	------

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.									
Engineering	bmammen	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1121/1				
Engr. Date	6/5/2017	Doc. Approved By	M. Campbell	Doc. Issued	9/20/2019				


# Motor Connection Diagrams <a href="mailto:12">12 Leads</a>

## Across-the-Line Starting / Running Connections

Low Voltage Delta



High Voltage Delta

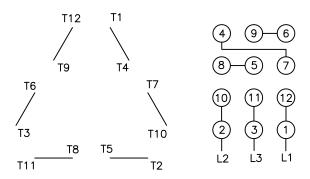

Switch L1 and L2 to reverse rotation

Suitable for Wye-Delta Starting and Limited Part-Winding-Starting. Please Contact Toshiba International for specific connections.

By: R. Murillo Date: 4/9/08 Checked: MDC Date: 5/17/11 Revision 1