



Issued Date	7/19/2021	Transmit #	
Issued By	dschoeck	Issued Rev	

TYPICAL MOTOR PERFORMANCE DATA

Model: 0054SDBC44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
5	3.7	4	1755	184TC	575	60	3	5.1
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	55	F	1.15	CONT	89.5	В		40 C

Load	HP	HP kW Amperes		Efficiency (%)	Power Factor (%)	
Full Load	5.00	3.7	5.1	89.3	82.3	
¾ Load	3.75	2.8	4.0	89.2	77.1	
½ Load	2.50	1.9	3.2	87.5	66.2	
¼ Load	1.25	0.9	2.2	81.2	51.4	
No Load			2.1		6.3	
Locked Rotor			36		47.8	

Torque						
Full Load Locked Rotor Pull Up Break Down						
(lb-ft)	(% FLT)	(% FLT)	(% FLT)	(lb-ft²)		
15.0	250	235	365	0.50		

Safe Stall Time(s)		Sound	Bearin	Approx. Motor Weight		
Cold	Hot	Pressure	Bearings*		Approx. Motor Weight	
Cold		dB(A) @ 1M	DE NDE		(lbs)	
35	15	-	6306ZZC3	6306ZZC3	119	

*Bearings are the only recommended spare part(s).

Motor Options: Product Family:EQP Global Brake Mounting:C-Face Footed,Shaft:T Shaft Brake Torque (lb-ft): 25.00

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.							
Engineering	mcampbell	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 0		
Engr. Date	4/9/2018	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011		




Issued Date	7/19/2021	Transmit #	
Issued By	dschoeck	Issued Rev	

SPEED TORQUE/CURRENT CURVE

Model: 0054SDBC44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
5	3.7	4	1755	184TC	575	60	3	5.1
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	55	F	1.15	CONT	89.5	В		40 C
Locked Rotor	Rotor wk ²				Torque			
Amps	Inertia	Full Load	Locked	Rotor	Pull Up)	Break	Down
Allips	(lb-ft²)	(lb-ft)	(%	(%)			(%	6)
36	0.50	15.0	250		235		36	35

Design Values

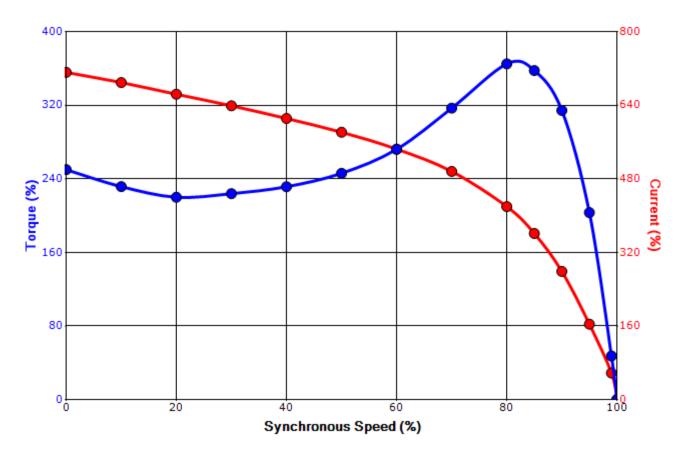




Customer	wk² Load Inertia (lb-ft²)	-
Customer PO	Load Type	-
Sales Order	Voltage (%)	100
Project #	Accel. Time	_


Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.								
Engineering	Engineering mcampbell Doc. Written By D. Suarez Doc.# / Rev							
Engr. Date	4/9/2018	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011			

Motor Connection Diagram 3 Leads - Wye Connection Single Voltage

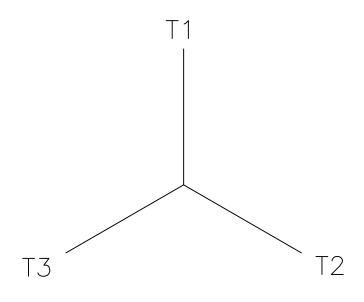



Switch L1 and L2 to reverse rotation

Each lead may consist of more than one cable. If multiple cables represent a single lead, each one of them will be labeled with the appropriate lead number.

By: R. Murillo Date: 4/9/08 Checked: Date: Revision 0