
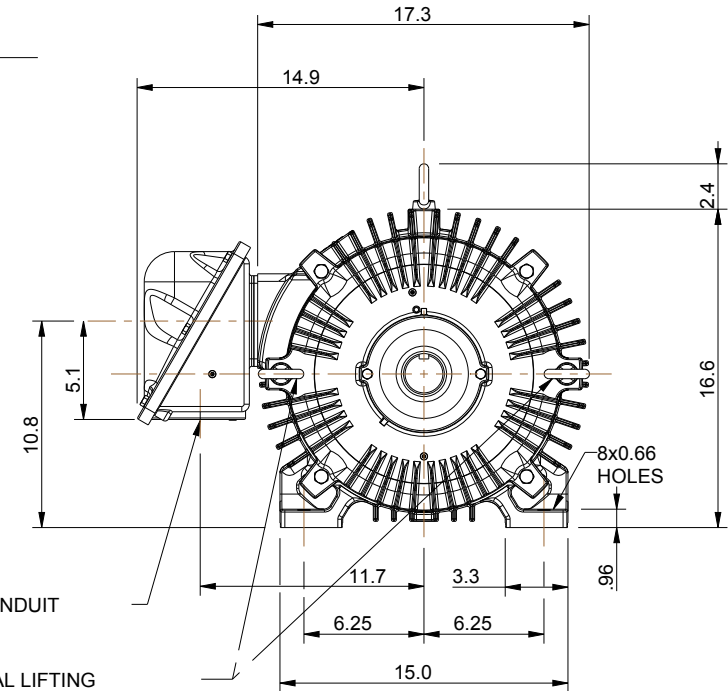
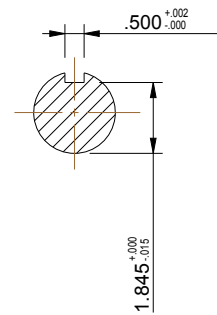
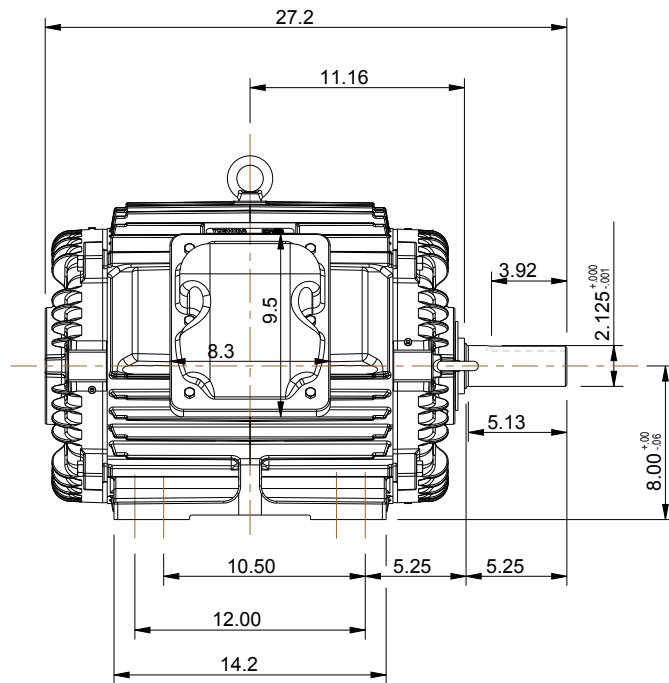




2.00" NPT CONDUIT

EYEBOLTS FOR VERTICAL LIFTING

UNITS: INCHES

BEARINGS		APPROX. WEIGHT
LS	OS	
6312ZZC3	6312ZZC3	651 lbs

- NOTES:
1. MAIN CONDUIT BOX MAY BE ROTATED IN 90 INCREMENTS
 2. STANDARD PRODUCT USE BI-DIRECTIONAL FAN. OPPOSITE ROTATION AVAILABLE ONLY BY CONNECTION CHANGE.
 3. KEY DIMENSIONS EQUAL (MOTOR SUPPLIED WITH KEY)
- 0.500" x 0.500" x 3.88"

CUSTOMER: _____ MOTOR MODEL NO.: _____
P.O. NO.: _____ HP: _____ VOLTAGE: _____ RPM(SYN.): _____ HZ: _____
FRAME SIZE: 320T PRODUCT TYPE: COOLING TOWER
COMMENTS: _____

PER: _____ DATE: _____

TAG NUMBERS

- ☒ STANDARD (NO AUX. BOXES)
☐ RTD AUX. BOX
☐ SPACE HEATER AUX. BOX
☐ BEARING RTD's

TOSHIBA RESERVES THE RIGHT TO MAKE CHANGES OF TECHNICAL IMPROVEMENT AND THE DATA MAY CHANGE WITHOUT NOTICE

☒ PRELIMINARY

DO NOT USE FOR CONSTRUCTION, INSTALLATION, OR APPLICATION PURPOSES UNLESS THE DRAWING IS MARKED AS CERTIFIED

☐ CERTIFIED

TOSHIBA
TOSHIBA INTERNATIONAL CORPORATION

MDSLV505-06
TOTALLY ENCLOSED AIR OVER
3 PHASE INDUCTION MOTOR
F1 ASSEMBLY

SEVERE DUTY
EQP Global CT
XT SERIES
www.toshiba.com/ind



Issued Date 9/24/2019

Transmit #

Issued By dschoeck

Issued Rev

TYPICAL MOTOR PERFORMANCE DATA

Model: 0306FAGR41A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
30	22	6	1180	326T	230/460	60	3	74/37
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEAO	56	F	1.15	CONT	93	B	G	40 C

Load	HP	kW	Amperes	Efficiency (%)	Power Factor (%)
Full Load	30	22.4	37.0	92.8	81.0
¾ Load	22.50	16.8	29.5	92.5	77.0
½ Load	15.00	11.2	23.1	91.1	66.7
¼ Load	7.50	5.6	15.7	85.9	51.8
No Load			14.7		4.7
Locked Rotor			217		41.5

Torque				Rotor wk² Inertia (lb-ft²)
Full Load (lb-ft)	Locked Rotor (% FLT)	Pull Up (% FLT)	Break Down (% FLT)	
134	220	170	265	12.34

Safe Stall Time(s)		Sound Pressure dB(A) @ 1M	Bearings*		Approx. Motor Weight (lbs)
Cold	Hot		DE	NDE	
35	15	-	6312ZZC3	6312ZZC3	

*Bearings are the only recommended spare part(s).

Motor Options:

Mounting: Footed, Shaft: T Shaft

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.

Engineering	bmammen	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 1
Engr. Date	6/18/2019	Doc. Approved By	M. Campbell	Doc. Issued	9/20/2019

TOSHIBA

Issued Date 9/24/2019

Transmit #

Issued By dschoeck



Issued Rev

SPEED TORQUE/CURRENT CURVE

Model: 0306FAGR41A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
30	22	6	1180	326T	230/460	60	3	74/37
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEAO	56	F	1.15	CONT	93	B	G	40 C
Locked Rotor Amps	Rotor wk ² Inertia (lb-ft ²)	Torque						
		Full Load (lb-ft)	Locked Rotor (%)		Pull Up (%)		Break Down (%)	
217	12.34	134	220		170		265	

Design Values

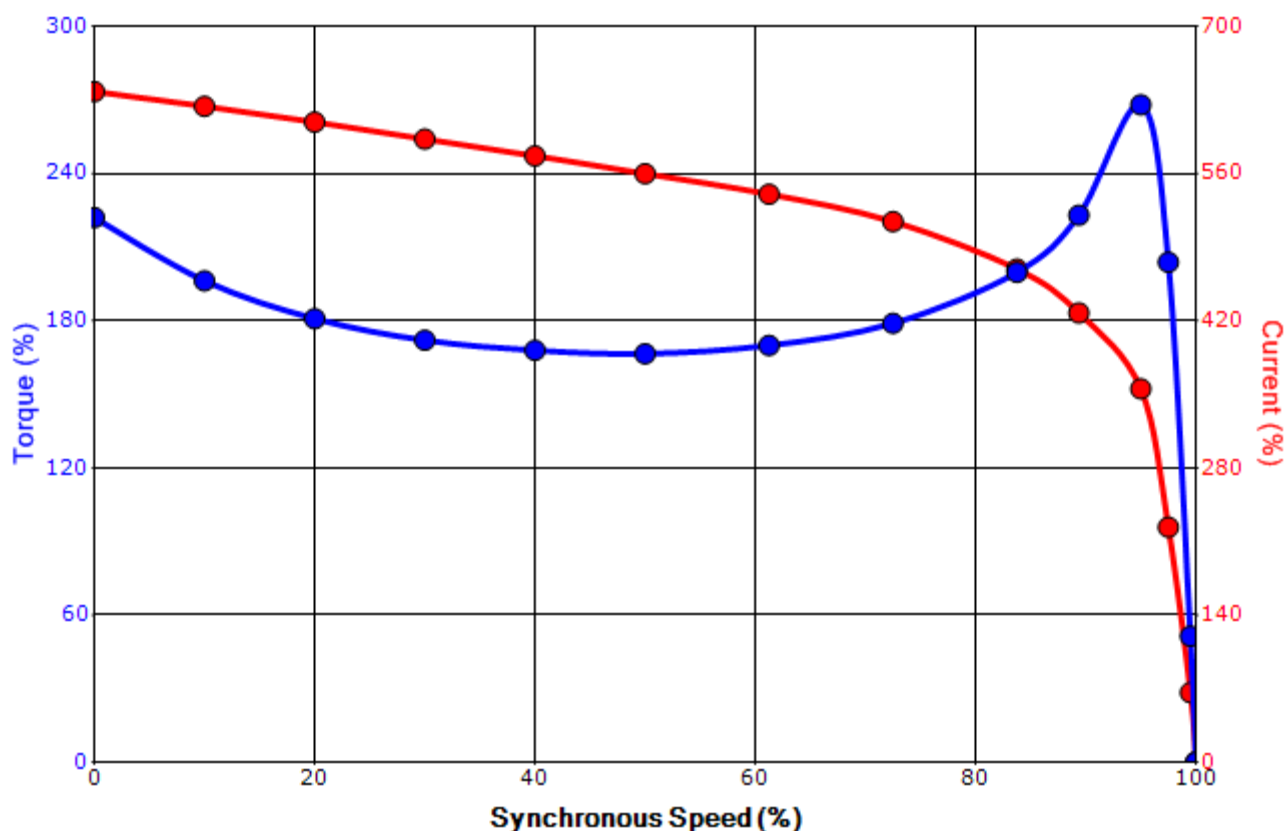

Customer		wk ² Load Inertia (lb-ft ²)	-
Customer PO		Load Type	-
Sales Order		Voltage (%)	100
Project #		Accel. Time	-

Tag:

All characteristics are average expected values.


TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.

Engineering	bmammen	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1121/1
Engr. Date	6/18/2019	Doc. Approved By	M. Campbell	Doc. Issued	9/20/2019


Motor Connection Diagrams
12 Leads

Across-the-Line Starting / Running Connections

Low Voltage Delta

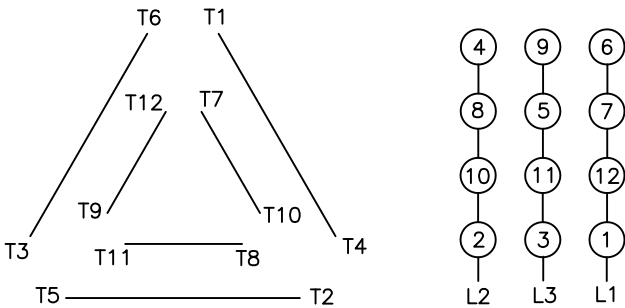

High Voltage Delta

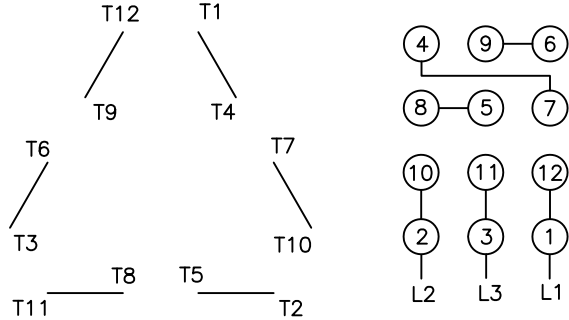

Switch L1 and L2 to reverse rotation

Suitable for Wye-Delta Starting and Limited Part-Winding-Starting.
Please Contact Toshiba International for specific connections.