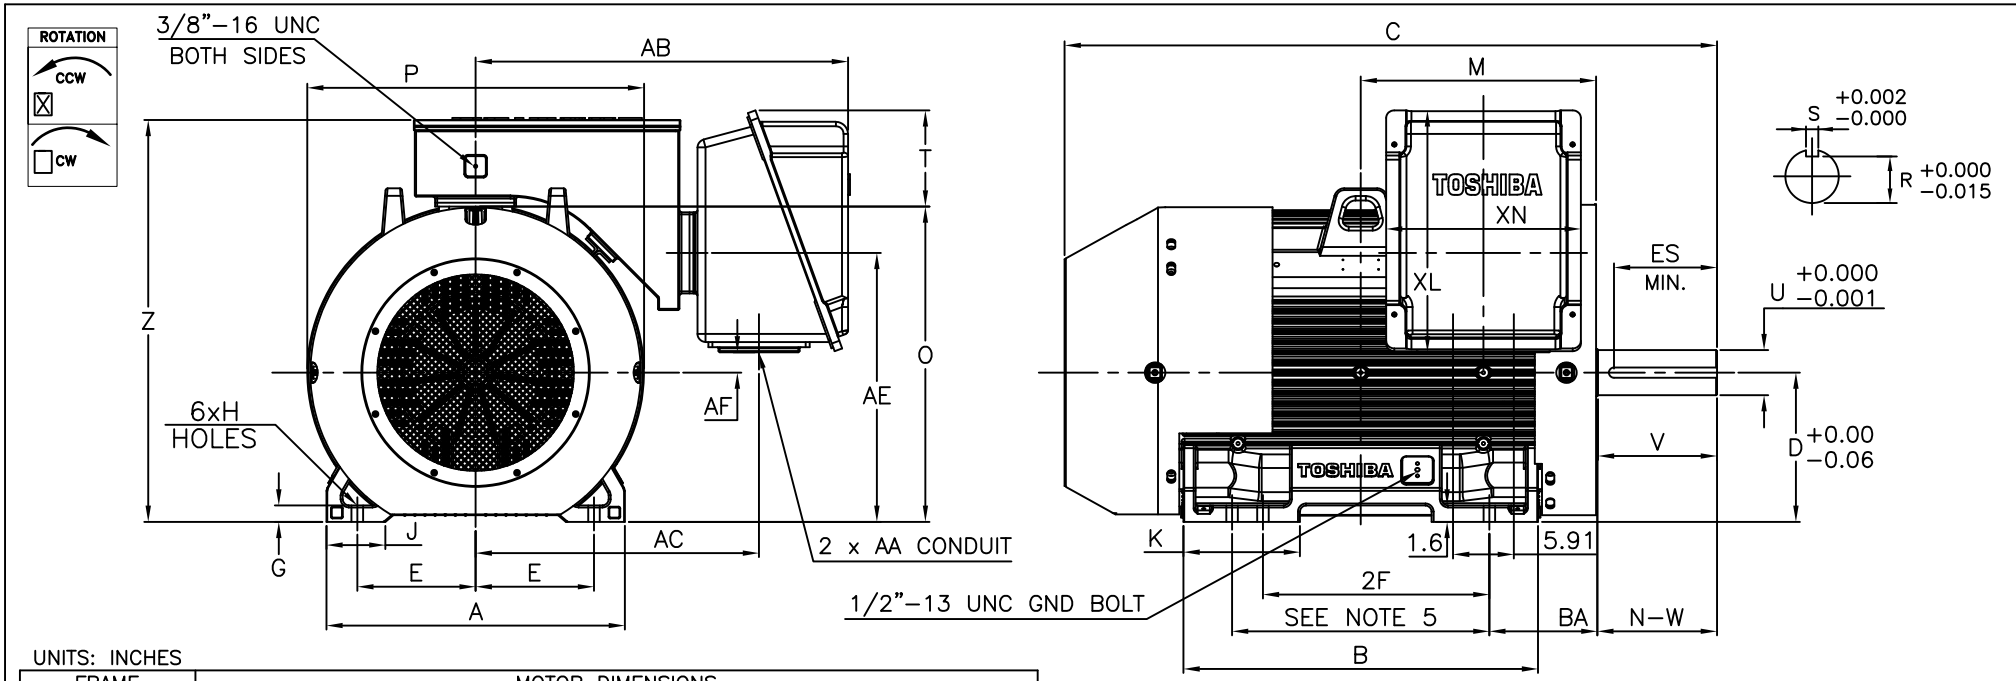

UNITS: INCHES

FRAME SIZE	MOTOR DIMENSIONS											
	A	B	C	D	G	J	K	M	O	P	T	Z
S586/7LQ	29.0	34.5	63.4	14.5	1.58	5.7	11.3	22.9	30.6	32.7	9.3	39.2
S586/7L	29.0	34.5	63.4	14.5	1.58	5.7	11.3	22.9	30.6	32.7	9.3	39.2
S586/7LS	29.0	34.5	60.0	14.5	1.58	5.7	11.3	22.9	30.6	32.7	9.3	39.2

FRAME SIZE	CONDUIT BOX						
	AA[NPT]	AB	AC	AE	AF	XL	XN
S586/7LQ/L/LS	3.00	36.2	27.5	26.1	1.97	23.5	18.9

FRAME SIZE	MOUNTING				SHAFT EXTENSION			KEY SEAT			BEARINGS			MAXIMUM WEIGHT
	E	2F	H	BA	N–W	V	U	R	S	ES	LS ROLLER	LS BALL	OS BALL	
S586/7LQ	11.5	22.00/25.00	1.19	10.0	11.625	11.56	4.375	3.817	1.00	10.00	NU324C3	6324C3	6320C3	6000 lbs.
S586/7L	11.5	22.00/25.00	1.19	10.0	11.625	11.56	3.875	3.309	1.00	10.00	NU322C3	6322C3	6320C3	6000 lbs.
S586/7LS	11.5	22.00/25.00	1.19	10.0	8.25	8.19	3.875	3.309	1.00	6.30	NU322C3	6322C3	6320C3	6000 lbs.

NOTES:
1. DIMENSION V REPRESENTS LENGTH OF STRAIGHT PART OF SHAFT.
2. MAIN CONDUIT BOX MAY BE ROTATED IN 90° INCREMENTS.
3. "LQ" KEY DIMENSIONS EQUAL S x S x 10.00
   "L" KEY DIMENSIONS EQUAL S x S x 10.00
   "LS" KEY DIMENSIONS EQUAL S x S x 6.30
   (MOTOR SUPPLIED WITH KEY)
4. MOTOR WEIGHT SHOWN IS MAXIMUM HORSEPOWER IN FRAME.
5. THIS DIMENSION EQUALS 2F FOR 587 MOUNTING.
6. STANDARD PRODUCT USE BI–DIRECTIONAL FAN. OPPOSITE ROTATION AVAILABLE ONLY BY CONNECTION CHANGE.
7. FRAME GROUND BOLT STANDARD.

CUSTOMER: _____ MOTOR MODEL NO.: _____

P.O. NO.: _____ HP: _____ VOLTAGE: _____ RPM(SYN.): _____ Hz: _____

FRAME SIZE: _____ PRODUCT TYPE: TEFC PREMIUM EFFICIENCY QUARRY DUTY

COMMENTS: _____

PER: _____ DATE: _____

TAG NO's.:

- [X] STANDARD (NO AUX. BOXES)
- [ ] RTD AUX. BOX
- [ ] SPACE HEATER AUX. BOX
- [ ] BEARING RTD's

TOSHIBA RESERVES THE RIGHT TO MAKE CHANGES OF TECHNICAL IMPROVEMENT AND THE DATA MAY CHANGE WITHOUT NOTICE [X] PRELIMINARY

DO NOT USE FOR CONSTRUCTION, INSTALLATION, OR APPLICATION PURPOSES UNLESS THE DRAWING IS MARKED AS CERTIFIED [ ] CERTIFIED

TOSHIBA

TOSHIBA INTERNATIONAL CORPORATION

TOTALLY–ENCLOSED FAN–COOLED HORIZONTAL FOOT–MOUNTED 3 PHASE INDUCTION MOTOR F1 ASSEMBLY

XT SERIES

VISIT OUR WEBSITE AT:
www.toshiba.com/ind

Issued Date	6/28/2024	Transmit #	
Issued By	dschoeck	Issued Rev	

TOSHIBA
Leading Innovation >>>

TYPICAL MOTOR PERFORMANCE DATA

Model: 3006QDSC41A-R

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
300	224	6	1190	S587LQ	575	60	3	301

Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	54	F	1.15	CONT	96.2	A		40 C

Load	HP	kW	Amperes	Efficiency (%)	Power Factor (%)
Full Load	300.00	223.7	301	96.4	77.4
¾ Load	225.00	167.8	238	95.8	73.8
½ Load	150.00	111.9	182	94.5	65.3
¼ Load	75.00	55.9	138	90.1	45.0
No Load			134.5		2.7
Locked Rotor			2097		24.8

Torque				Rotor wk² Inertia
Full Load (lb-ft)	Locked Rotor (% FLT)	Pull Up (% FLT)	Break Down (% FLT)	(lb-ft²)
1324	190	175	290	303.04

Safe Stall Time(s)		Sound Pressure dB(A) @ 1M	Bearings*		Approx. Motor Weight
Cold	Hot		DE	NDE	(lbs)
25	15		NU324C3	6320C3	

*Bearings are the only recommended spare part(s).

Motor Options:
Product Family:Quarry
Mounting:Footed,Shaft:"LQ" SHAFT
Motor Specification:Quarry Duty

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.

Engineering	SSuryani	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 0
Engr. Date	6/25/2021	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011

Issued Date	6/28/2024	Transmit #	
Issued By	dschoeck	Issued Rev	

TOSHIBA
Leading Innovation >>>

SPEED TORQUE/CURRENT CURVE

Model: 3006QDSC41A-R

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
300	224	6	1190	S587LQ	575	60	3	301

Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	54	F	1.15	CONT	96.2	A		40 C

Locked Rotor Amps	Rotor wk² Inertia (lb-ft²)	Torque			
		Full Load (lb-ft)	Locked Rotor (%)	Pull Up (%)	Break Down (%)
2097	303.04	1324	190	175	290

Design Values

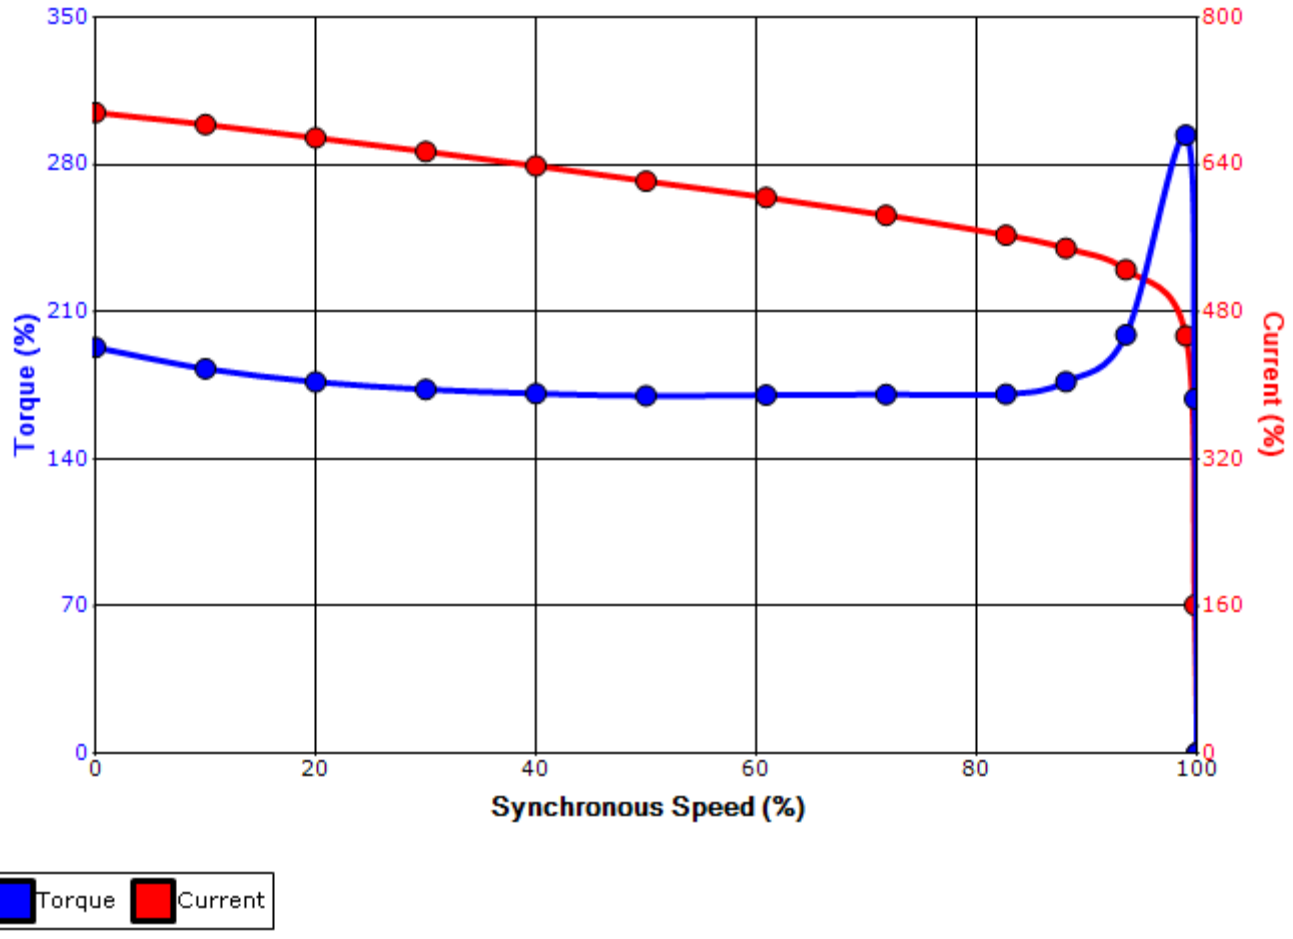

Customer			wk² Load Inertia (lb-ft²)	-
Customer PO			Load Type	-
Sales Order			Voltage (%)	100
Project #			Accel. Time	-

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.

Engineering	SSuryani	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1121 / 0
Engr. Date	6/25/2021	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011

Motor Connection Diagram
3 Leads - Delta Connection

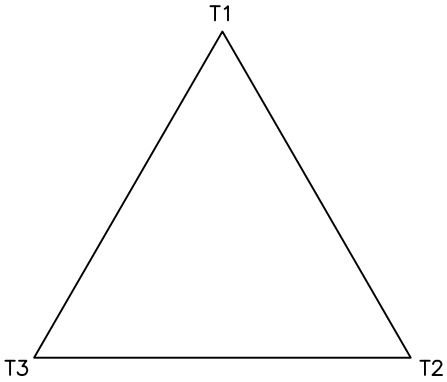

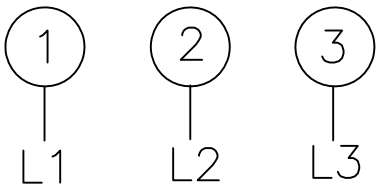

Switch L1 and L2 to reverse rotation

Each lead may consist of more than one cable.
If multiple cables represent a single lead, each one of them will be labeled with the appropriate lead number.

Issued Date:	6/28/2024	**Transmit #:**	
Issued By:	dschoeck	**Issued Rev:**	

TOSHIBA
Leading Innovation >>>

SPARE PARTS LIST*

Model: 3006QDSC41A-R

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
300	224	6	1190	S587LQ	575	60	3	301
Enclosure	**IP**	**Ins. Class**	**S.F.**	**Duty**	**NEMA Nom. Eff.**	**NEMA Design**	**kVA Code**	**Ambient (°C)**
TEFC	54	F	1.15	CONT	96.2	A		40 C

Bearings DE	NU324C3 / 120RU03M3OX
Bearings NDE	6320C3 / 100BC03J3OX

*Bearings are the only recommended spare part(s).

Other than the grease used for regreasable bearings and the oil used for oil-lubricated bearings, Toshiba advises that there are no "use" parts. The only insurance spares that Toshiba suggests for these squirrel-cage induction motors are industry-standard and commercially available off-the-shelf bearings as noted above.

Motor components such as terminal boxes, fan covers and other machined parts are available on special request. In these cases, please advise our order entry department of the model and serial numbers found on the motor nameplate and a description of the needed components. With this information they will be able to furnish the current part number, price and availability.

Note: Our internal part numbers are subject to change without notice and are not published.

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.

Engineering	SSuryani	**Doc. Written By**	D. Suarez	**Doc.# / Rev**	MPCF-1125 / 0
Engr. Date	6/25/2021	**Doc. Approved By**	M. Campbell	**Doc. Issued**	6/8/2011