

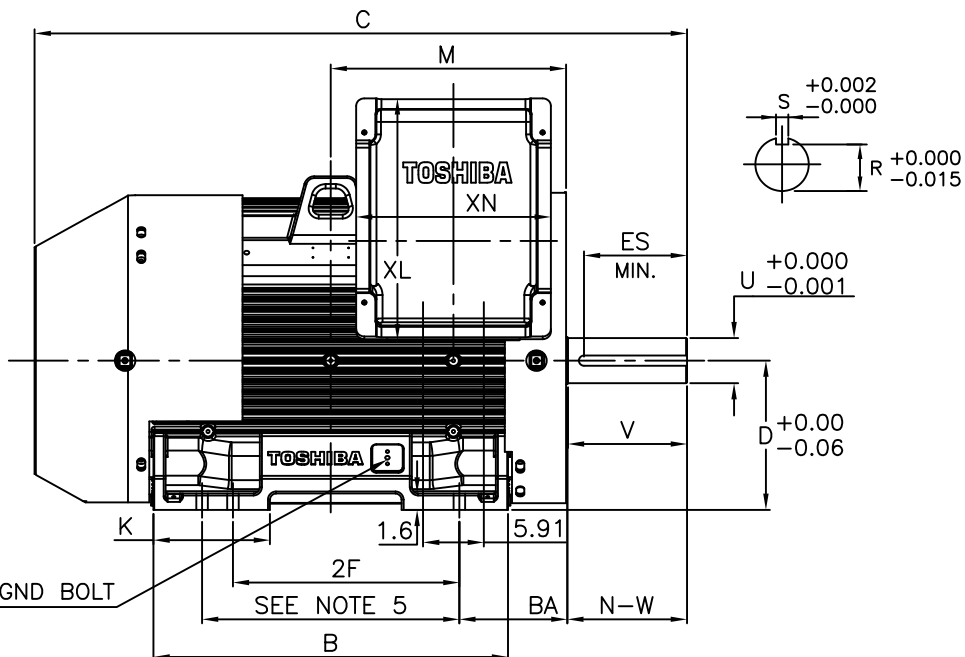


3/8"-16 UNC  
BOTH SIDES

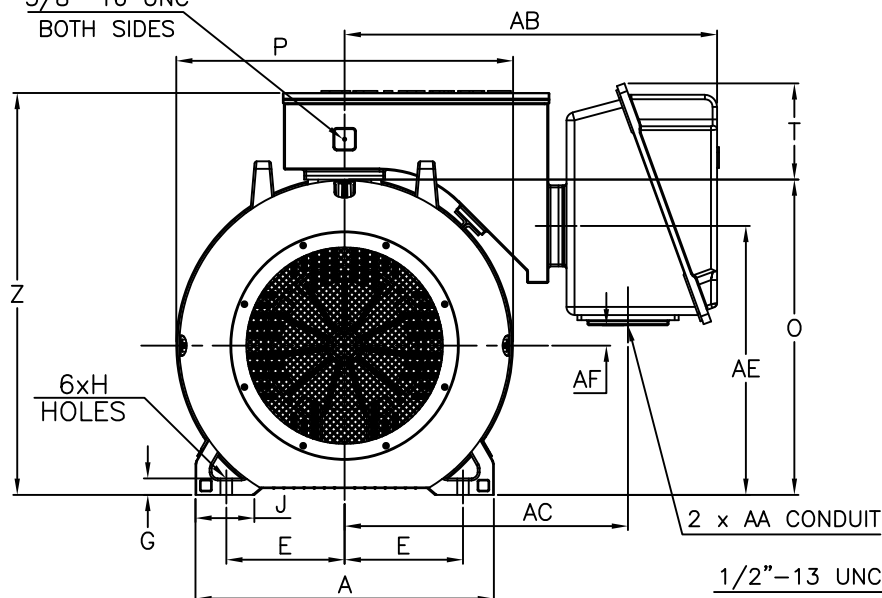

UNITS: INCHES

FRAME SIZE	MOTOR DIMENSIONS											
	A	B	C	D	G	J	K	M	O	P	T	Z
S586/7LQ	29.0	34.5	63.4	14.5	1.58	5.7	11.3	22.9	30.6	32.7	9.3	39.2
S586/7L	29.0	34.5	63.4	14.5	1.58	5.7	11.3	22.9	30.6	32.7	9.3	39.2
S586/7LS	29.0	34.5	60.0	14.5	1.58	5.7	11.3	22.9	30.6	32.7	9.3	39.2

FRAME SIZE	CONDUIT BOX						
	AA[NPT]	AB	AC	AE	AF	XL	XN
S586/7LQ/L/LS	3.00	36.2	27.5	26.1	1.97	23.5	18.9

FRAME SIZE	MOUNTING				SHAFT EXTENSION			KEY SEAT			BEARINGS			MAXIMUM WEIGHT
	E	2F	H	BA	N-W	V	U	R	S	ES	LS ROLLER	LS BALL	OS BALL	
S586/7LQ	11.5	22.00/25.00	1.19	10.0	11.625	11.56	4.375	3.817	1.00	10.00	NU324C3	6324C3	6320C3	6000 lbs.
S586/7L	11.5	22.00/25.00	1.19	10.0	11.625	11.56	3.875	3.309	1.00	10.00	NU322C3	6322C3	6320C3	6000 lbs.
S586/7LS	11.5	22.00/25.00	1.19	10.0	8.25	8.19	3.875	3.309	1.00	6.30	NU322C3	6322C3	6320C3	6000 lbs.

NOTES:

1. DIMENSION V REPRESENTS LENGTH OF STRAIGHT PART OF SHAFT.
2. MAIN CONDUIT BOX MAY BE ROTATED IN 90° INCREMENTS.
3. "LQ" KEY DIMENSIONS EQUAL S x S x 10.00  
"L" KEY DIMENSIONS EQUAL S x S x 10.00  
"LS" KEY DIMENSIONS EQUAL S x S x 6.30  
(MOTOR SUPPLIED WITH KEY)
4. MOTOR WEIGHT SHOWN IS MAXIMUM HORSEPOWER IN FRAME.
5. THIS DIMENSION EQUALS 2F FOR 587 MOUNTING.
6. STANDARD PRODUCT USE BI-DIRECTIONAL FAN. OPPOSITE ROTATION AVAILABLE ONLY BY CONNECTION CHANGE.
7. FRAME GROUND BOLT STANDARD.

CUSTOMER: \_\_\_\_\_ MOTOR MODEL NO.: \_\_\_\_\_

P.O. NO.: \_\_\_\_\_ HP: \_\_\_\_\_ VOLTAGE: \_\_\_\_\_ RPM(SYN.): \_\_\_\_\_ Hz: \_\_\_\_\_

FRAME SIZE: \_\_\_\_\_ PRODUCT TYPE: TEFC PREMIUM EFFICIENCY QUARRY DUTY

COMMENTS: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

PER: \_\_\_\_\_ DATE: \_\_\_\_\_

TAG NO's: \_\_\_\_\_

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

- ☒ STANDARD (NO AUX. BOXES)
- ☐ RTD AUX. BOX
- ☐ SPACE HEATER AUX. BOX
- ☐ BEARING RTD's

TOSHIBA RESERVES THE RIGHT TO MAKE CHANGES OF TECHNICAL IMPROVEMENT AND THE DATA MAY CHANGE WITHOUT NOTICE ☒ PRELIMINARY

DO NOT USE FOR CONSTRUCTION, INSTALLATION, OR APPLICATION PURPOSES UNLESS THE DRAWING IS MARKED AS CERTIFIED ☐ CERTIFIED

# TOSHIBA

TOSHIBA INTERNATIONAL CORPORATION

TOTALLY-ENCLOSED FAN-COOLED  
HORIZONTAL FOOT-MOUNTED  
3 PHASE INDUCTION MOTOR  
F1 ASSEMBLY

## XT SERIES

VISIT OUR WEBSITE AT:  
[www.toshiba.com/ind](http://www.toshiba.com/ind)

## TYPICAL MOTOR PERFORMANCE DATA

Model: 3506QDSC41A-R

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
350	261	6	1190	S587LQ	575	60	3	353
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	54	F	1.15	CONT	96.2	A		40 C

Load	HP	kW	Amperes	Efficiency (%)	Power Factor (%)
Full Load	350.00	261.0	353	96.5	76.9
¾ Load	262.50	195.7	280	96.1	73.1
½ Load	175.00	130.5	215	94.8	64.2
¼ Load	87.50	65.2	165	90.8	43.7
No Load			162.3		
Locked Rotor			2466		

Torque				Rotor wk² Inertia (lb-ft²)
Full Load (lb-ft)	Locked Rotor (% FLT)	Pull Up (% FLT)	Break Down (% FLT)	
1545	195	175	295	323.24

Safe Stall Time(s)		Sound Pressure dB(A) @ 1M	Bearings*		Approx. Motor Weight (lbs)
Cold	Hot		DE	NDE	
22	12		NU324C3	6320C3	

\*Bearings are the only recommended spare part(s).

**Motor Options:**  
Product Family:Quarry  
Mounting:Footed,Shaft:"LQ" SHAFT  
Motor Specification:Quarry Duty

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

All characteristics are average expected values.

**TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.**



Engineering	SSuryani	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 0
Engr. Date	6/25/2021	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011

## SPEED TORQUE/CURRENT CURVE

Model: 3506QDSC41A-R

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
350	261	6	1190	S587LQ	575	60	3	353
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	54	F	1.15	CONT	96.2	A		40 C
Locked Rotor Amps	Rotor wk <sup>2</sup> Inertia (lb-ft <sup>2</sup> )	Torque						
		Full Load (lb-ft)	Locked Rotor (%)	Pull Up (%)		Break Down (%)		
2466	323.24	1545	195	175		295		

### Design Values

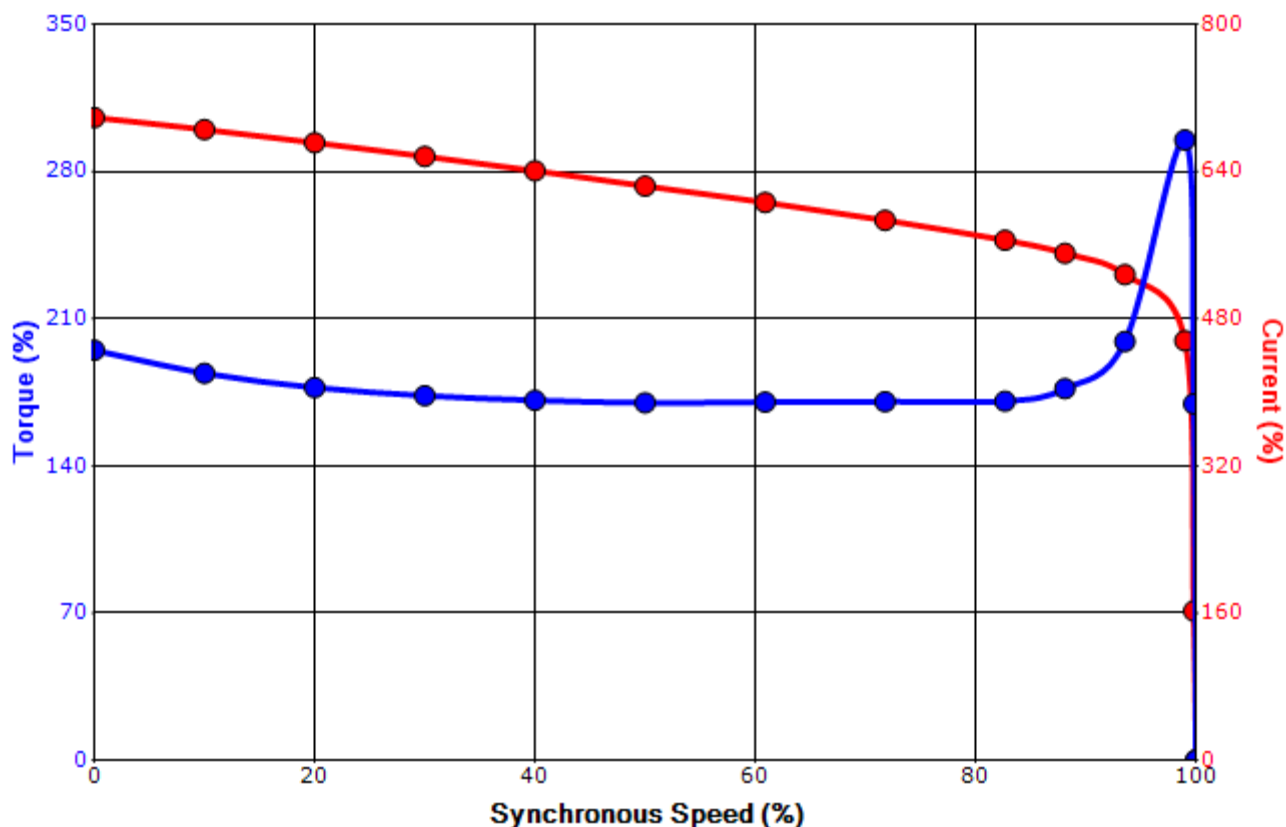

Customer			wk <sup>2</sup> Load Inertia (lb-ft <sup>2</sup> )	-
Customer PO			Load Type	-
Sales Order			Voltage (%)	100
Project #			Accel. Time	-

Tag:

All characteristics are average expected values.

**TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.**

Engineering	SSuryani	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1121 / 0
Engr. Date	6/25/2021	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011

**Motor Connection Diagram**  
3 Leads - Delta Connection

Switch L1 and L2 to reverse rotation

Each lead may consist of more than one cable.  
If multiple cables represent a single lead, each one  
of them will be labeled with the appropriate lead number.

## SPARE PARTS LIST\*

**Model:** 3506QDSC41A-R

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
350	261	6	1190	S587LQ	575	60	3	353
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	54	F	1.15	CONT	96.2	A		40 C

**Bearings DE** NU324C3 / 120RU03M3OX

**Bearings NDE** 6320C3 / 100BC03J3OX

\*Bearings are the only recommended spare part(s).

Other than the grease used for regreasable bearings and the oil used for oil-lubricated bearings, Toshiba advises that there are no "use" parts. The only insurance spares that Toshiba suggests for these squirrel-cage induction motors are industry-standard and commercially available off-the-shelf bearings as noted above.

Motor components such as terminal boxes, fan covers and other machined parts are available on special request. In these cases, please advise our order entry department of the model and serial numbers found on the motor nameplate and a description of the needed components. With this information they will be able to furnish the current part number, price and availability.

Note: Our internal part numbers are subject to change without notice and are not published.

<b>Customer</b>		
<b>Customer PO</b>		
<b>Sales Order</b>		
<b>Project #</b>		

**Tag:**

All characteristics are average expected values.

**TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.**

<b>Engineering</b>	SSuryani	<b>Doc. Written By</b>	D. Suarez	<b>Doc.# / Rev</b>	MPCF-1125 / 0
<b>Engr. Date</b>	6/25/2021	<b>Doc. Approved By</b>	M. Campbell	<b>Doc. Issued</b>	6/8/2011