

UNITS: INCHES

(MOTOR SUPPLIED WITH KEY)

TOSHIBA RESERVES THE RIGHT TO MAKE CHANGES OF TECHNICAL IMPROVEMENT WITHOUT NOTICE. DO NOT USE FOR CONSTRUCTION, INSTALLATION, OR APPLICATION PURPOSES UNLESS THE DRAWING IS CERTIFIED.

TOLERANCES 210T-BRAKE TEFC FRAME F1 ASSEMBLY .XX .03 .XXX.005 XXXX. .0005 **XT SERIES** MDSLV131-03 MAXIMUM MOTOR WEIGHT M. EASTERBROOK DRAWN BY: CHECK BY: 186 lbs. 0 FIRST ISSUE M.EASTERBROOK 6/4/2013 APPROVED BY: 84 kgs. NO DRAWN BY DATE CHECK **TOSHIBA INTERNATIONAL CORPORATION** REVISION www.toshiba.com/ind



| Issued Date | 6/20/2025 | Transmit # | |
|-------------|-----------|------------|--|
| Issued By | dschoeck | Issued Rev | |

TYPICAL MOTOR PERFORMANCE DATA

Model: Y754SDBA41A-P

| HP | kW | Pole | FL RPM | Frame | Voltage | Hz | Phase | FL Amps |
|-----------|-----|------------|--------|-------|-------------------|----------------|----------|-----------------|
| 7.50 | 5.5 | 4 | 1770 | 213T | 230/460 | 60 | 3 | 20.6/10.3 |
| Enclosure | IP | Ins. Class | S.F. | Duty | NEMA Nom. Eff. | NEMA Design | kVA Code | Ambient (°C) |
| TEFC | 55 | F | 1.15 | CONT | 91.7 | В | | 40 C |

| Load | HP | kW | Amperes | Efficiency (%) | Power Factor (%) |
|-------------|------|-----|---------|----------------|------------------|
| Full Load | 7.50 | 5.6 | 10.3 | 91.8 | 74.6 |
| ¾ Load | 5.62 | 4.2 | 8.4 | 90.5 | 68.8 |
| ∕₂ Load | 3.75 | 2.8 | 6.8 | 87.5 | 58.4 |
| 4 Load | 1.87 | 1.4 | 4.6 | 80.6 | 46.9 |
| No Load | | | 5.7 | | 5.0 |
| ocked Rotor | | | 63 | | 39.8 |

| Torque | | | | | | | | |
|-----------|--------------|---------|------------|----------|--|--|--|--|
| Full Load | Locked Rotor | Pull Up | Break Down | Inertia | | | | |
| (lb-ft) | (% FLT) | (% FLT) | (% FLT) | (lb-ft²) | | | | |
| 22.3 | 260 | 195 | 315 | 1.15 | | | | |

| Safe Stall | all Time(s) Sound | | Bearin | Approx. Motor Weight | |
|------------|-------------------|------------|----------|----------------------|----------------------|
| Cold | Hot | Pressure | Beal III | | Approx. Motor Weight |
| Joid | 1100 | dB(A) @ 1M | DE | NDE | (lbs) |
| 35 | 15 | - | 6308ZZC3 | 6308ZZC3 | |

*Bearings are the only recommended spare part(s).

Motor Options: Product Family:EQP Global Brake Mounting:Footed,Shaft:T Shaft Brake Torque (lb-ft): 35.00

| Customer | |
|-------------|--|
| Customer PO | |
| Sales Order | |
| Project # | |

Tag:

| TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A. | | | | | | | | |
|-----------------------------------------------------------|----------|------------------|-------------|-------------|---------------|--|--|--|
| Engineering | bmammen | Doc. Written By | D. Suarez | Doc.# / Rev | MPCF-1119 / 0 | | | |
| Engr. Date | 5/5/2025 | Doc. Approved By | M. Campbell | Doc. Issued | 6/8/2011 | | | |



| Issued Date | 6/20/2025 | Transmit # | |
|-------------|-----------|------------|--|
| Issued By | dschoeck | Issued Rev | |

TYPICAL MOTOR PERFORMANCE DATA

Model: Y754SDBA41A-P

| HP | kW | Pole | FL RPM | Frame | Voltage | Hz | Phase | FL Amps |
|-----------|-----|------------|--------|-------|-------------------|----------------|----------|-----------------|
| 7.50 | 5.5 | 4 | 1450 | 213T | 190/380 | 50 | 3 | 22.8/11.4 |
| Enclosure | IP | Ins. Class | S.F. | Duty | NEMA Nom. Eff. | NEMA Design | kVA Code | Ambient (°C) |
| TEFC | 55 | F | 1.0 | CONT | 90.5 | В | | 40 C |

| Load | HP | kW | Amperes | Efficiency (%) | Power Factor (%) |
|--------------|------|-----|---------|----------------|------------------|
| Full Load | 7.50 | 5.6 | 11.4 | 90.6 | 82.7 |
| ¾ Load | 5.62 | 4.2 | 9.0 | 90.2 | 78.1 |
| ½ Load | 3.75 | 2.8 | 7.0 | 88.2 | 68.4 |
| ¼ Load | 1.87 | 1.4 | 4.7 | 81.8 | 54.2 |
| No Load | | | 4.5 | | 6.3 |
| Locked Rotor | | | 66 | | 42.0 |

| Torque | | | | | | | |
|-----------|--------------|---------|------------|----------|--|--|--|
| Full Load | Locked Rotor | Pull Up | Break Down | Inertia | | | |
| (lb-ft) | (% FLT) | (% FLT) | (% FLT) | (lb-ft²) | | | |
| 27.2 | 220 | 165 | 275 | 1.15 | | | |

| Safe Stall | Time(s) | Sound | Bearin | Approx. Motor Weight | | |
|------------|---------|------------|----------|----------------------|----------------------|--|
| Cold | Hot | Pressure | Bearin | 95 | Approx. Wotor Weight | |
| Colu | 1100 | dB(A) @ 1M | DE | NDE | (lbs) | |
| 32 | 23 | - | 6308ZZC3 | 6308ZZC3 | | |

*Bearings are the only recommended spare part(s).

Motor Options: Product Family:EQP Global Brake Mounting:Footed,Shaft:T Shaft Brake Torque (lb-ft): 35.00

| Customer | | |
|-------------|--|--|
| Customer PO | | |
| Sales Order | | |
| Project # | | |
| Tag: | | |

| All characteristics are average expected values. | | | | | | | |
|------------------------------------------------------------------|----------|------------------|-------------|-------------|----------|--|--|
| TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A. | | | | | | | |
| Engineering bmammen Doc. Written By D. Suarez Doc.# / Rev MPCF-1 | | | | | | | |
| Engr. Date | 5/5/2025 | Doc. Approved By | M. Campbell | Doc. Issued | 6/8/2011 | | |




| Issued Date | 6/20/2025 | Transmit # | |
|-------------|-----------|------------|--|
| Issued By | dschoeck | Issued Rev | |

SPEED TORQUE/CURRENT CURVE

Model: Y754SDBA41A-P

| HP | kW | Pole | FL RPM | Frame | Voltage | Hz | Phase | FL Amps |
|----------------------|-----------------------|------------|--------------|-------|-------------------|----------------|------------|-----------------|
| 7.50 | 5.5 | 4 | 1770 | 213T | 230/460 | 60 | 3 | 20.6/10.3 |
| Enclosure | IP | Ins. Class | S.F. | Duty | NEMA Nom. Eff. | NEMA Design | kVA Code | Ambient (°C) |
| TEFC | 55 | F | 1.15 | CONT | 91.7 | В | | 40 C |
| Looked Boton | Rotor wk ² | | | | Torque | | | |
| Locked Rotor Amps | Inertia | Full Load | Locked Rotor | | Pull Up | | Break Down | |
| Allips | (lb-ft²) | (lb-ft) | (% | (%) | | | (% | %) |
| 63 | 1.15 | 22.3 | 260 | | 195 | | 315 | |

Design Values

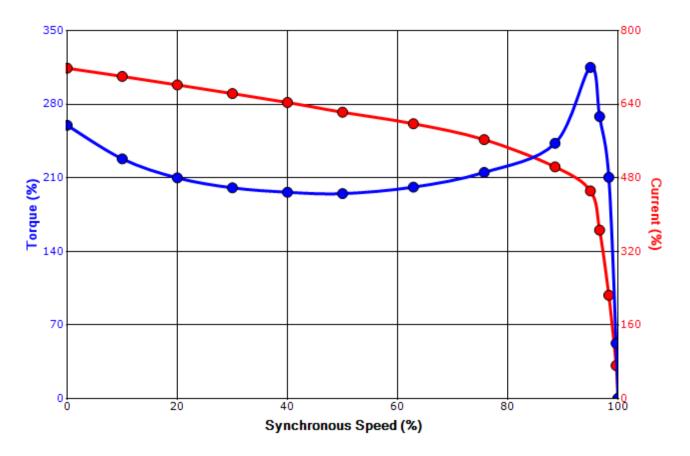



| Customer | wk² Load Inertia (Ib-f | 2) - |
|-------------|------------------------|--------|
| Customer PO | Load Typ | е - |
| Sales Order | Voltage (% | 6) 100 |
| Project # | Accel. Tim | е - |

Tag:

| TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A. | | | | | | | | |
|-----------------------------------------------------------|----------|------------------|-------------|-------------|---------------|--|--|--|
| Engineering | bmammen | Doc. Written By | D. Suarez | Doc.# / Rev | MPCF-1121 / 0 | | | |
| Engr. Date | 5/5/2025 | Doc. Approved By | M. Campbell | Doc. Issued | 6/8/2011 | | | |




| Issued Date | 6/20/2025 | Transmit # | |
|-------------|-----------|------------|--|
| Issued By | dschoeck | Issued Rev | |

SPEED TORQUE/CURRENT CURVE

Model: Y754SDBA41A-P

| HP | kW | Pole | FL RPM | Frame | Voltage | Hz | Phase | FL Amps |
|--------------|-----------------------|------------|--------|-------|-------------------|----------------|------------|-----------------|
| 7.50 | 5.5 | 4 | 1450 | 213T | 190/380 | 50 | 3 | 22.8/11.4 |
| Enclosure | IP | Ins. Class | S.F. | Duty | NEMA Nom. Eff. | NEMA Design | kVA Code | Ambient (°C) |
| TEFC | 55 | F | 1.0 | CONT | 90.5 | В | | 40 C |
| Locked Rotor | Rotor wk ² | | | | Torque | | | |
| Amps | Inertia | Full Load | Locked | Rotor | Pull Up | | Break Down | |
| Amps | (lb-ft²) | (lb-ft) | (%) | | (%) | | (% | %) |
| 66 | 1.15 | 27.2 | 220 | | 165 | | 2 | 75 |

Design Values

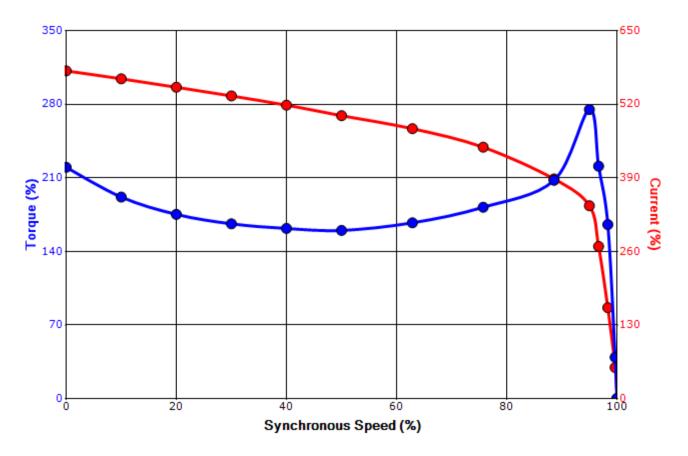



| Customer | wk² Load Inertia (Ib-f | 2) - |
|-------------|------------------------|--------|
| Customer PO | Load Typ | е - |
| Sales Order | Voltage (% | 6) 100 |
| Project # | Accel. Tim | е - |


Tag:

| TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A. | | | | | | | | |
|-----------------------------------------------------------|----------|------------------|-------------|-------------|---------------|--|--|--|
| Engineering | bmammen | Doc. Written By | D. Suarez | Doc.# / Rev | MPCF-1121 / 0 | | | |
| Engr. Date | 5/5/2025 | Doc. Approved By | M. Campbell | Doc. Issued | 6/8/2011 | | | |


Motor Connection Diagrams 12 Leads

Across-the-Line Starting / Running Connections

Low Voltage Delta

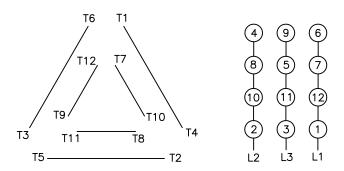

High Voltage Delta

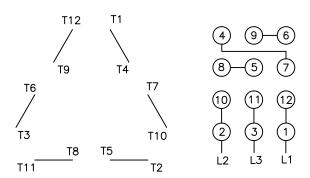

Switch L1 and L2 to reverse rotation

Suitable for Wye-Delta Starting and Limited Part-Winding-Starting. Please Contact Toshiba International for specific connections.

By: R. Murillo Date: 4/9/08 Checked: MDC Date: 5/17/11 Revision 1



| Issued Date: | 6/20/2025 | Transmit #: | |
|--------------|-----------|-------------|--|
| Issued By: | dschoeck | Issued Rev: | |

SPARE PARTS LIST*

Model: Y754SDBA41A-P

| HP | kW | Pole | FL RPM | Frame | Voltage | Hz | Phase | FL Amps |
|-----------|-----|------------|--------|-------|-------------------|----------------|----------|-----------------|
| 7.50 | 5.5 | 4 | 1770 | 213T | 230/460 | 60 | 3 | 20.6/10.3 |
| Enclosure | IP | Ins. Class | S.F. | Duty | NEMA Nom. Eff. | NEMA Design | kVA Code | Ambient (°C) |
| TEFC | 55 | F | 1.15 | CONT | 91.7 | В | | 40 C |

 Bearings DE
 6308ZZC3 / 40BC03JPP3OX

 Bearings NDE
 6308ZZC3 / 40BC03JPP3OX

*Bearings are the only recommended spare part(s).

Other than the grease used for regreasable bearings and the oil used for oil-lubricated bearings, Toshiba advises that there are no "use" parts. The only insurance spares that Toshiba suggests for these squirrel-cage induction motors are industry-standard and commercially available off-the-shelf bearings as noted above.

Motor components such as terminal boxes, fan covers and other machined parts are available on special request. In these cases, please advise our order entry department of the model and serial numbers found on the motor nameplate and a description of the needed components. With this information they will be able to furnish the current part number, price and availability.

Note: Our internal part numbers are subject to change without notice and are not published.

| Customer | |
|-------------|--|
| Customer PO | |
| Sales Order | |
| Project # | |

Tag:

| TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A. | | | | | | | |
|-----------------------------------------------------------|----------|------------------|-------------|-------------|---------------|--|--|
| Engineering | bmammen | Doc. Written By | D. Suarez | Doc.# / Rev | MPCF-1125 / 0 | | |
| Engr. Date | 5/5/2025 | Doc. Approved By | M. Campbell | Doc. Issued | 6/8/2011 | | |