
	╞┼╉┄┄╌╴┣┤	0.313 +0.002 0.000 0.000 000 000 000 000	0 10.6 10.6 10.6 10.6 10.6 1. MAIN CONDUIT BOX MAY BE ROTATED IN DOINGREMENTS
UNITS: INCHES BEARINGS APPROX. LS OS WEIGHT 6308ZZC3 6308ZZC3 186 lbs			2. STANDARD PRODUCT USE BI-DIRECTIONAL FAN. OPPOSITE ROTATION AVAILABLE ONLY BY CONNECTION CHANGE. 3. KEY DIMENSIONS EQUAL (MOTOR SUPPLIED WITH KEY)
CUSTOMER: MOTOR MOI P.O. NO.: HP: VOLTAGE: FRAME SIZE: 210T PRODUCT TYPE: COOLING TOWE COMMENTS:	RPM(SYN.): HZ:	TAG NUMBERS	X STANDARD (NO AUX. BOXES) Image: Constraint of the state of the sta
PER:	DATE:		BEARING RTD's
TOSHIBA RESERVES THE RIGHT TO MAKE CHANGES OF TECHNICA	L IMPROVEMENT AND THE DATA MAY	CHANGE WITHOUT NOTICE	X PRELIMINARY
DO NOT USE FOR CONSTRUCTION, INSTALLATION, OR APPLICATIO	N PURPOSES UNLESS THE DRAWING	S MARKED AS CERTIFIED	CERTIFIED
TOSHIBA INTERNATIONAL CORPORATION	MDSLV503 TOTALLY ENCLOSED 3 PHASE INDUCTIO F1 ASSEMI	FAN COOLED ON MOTOR	ECPGIODA CT XT SERIES www.toshiba.com/ind

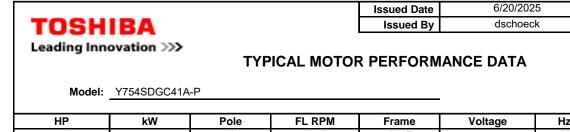

5/5/2025

Engr. Date

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	4	1770	213T	575	60	3	8.2
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	91.7	В		40 C
oad	HP	kW		eres	Efficiency	/ (%)		actor (%)
ull Load	7.50	5.6		.2	91.8			4.6
4 Load	5.62	4.2		.7	90.5			8.8
2 Load	3.75	2.8		.4	87.5			3.4
4 Load	1.87	1.4	3	.7	80.6		46	6.9
No Load				.5			5.0	
ocked Rotor			5	50			39	9.9
Full Lo	bad	Locked	Torqu I Rotor		ull Up	Bre	ak Down	Rotor wk
(lb-f	t)	(% F	FLT)		-		6 FLT)	(lb-ft²)
22.3			60	Ì	195	Ì	315	1.15
Safe Stall Time(s) Sound		Sound Pressure	Bearings*			Approx. Motor Weight		
Cold	Hot	dB(A) @ 1M	D	E	NDE		(It	os)
35	15	-		6308ZZC3 6308ZZC3		C3		
Notor Options: Mounting:Footed,SI	naft:T Shaft							
Customer Customer PO								
Sales Order								
Project #								
ag: Il characteristics are av	erage expected va	alues.						
			NATIONAL CO	ORPORATION ·	HOUSTON, TEX	AS U.S.A.		
Engineering	bm	ammen		Doc. Written By			Doc.#/Rev	MPCF-1119/0
	5/	5/2025		Dec. Assessed De	M. Osmah	-11		0/0/0044

Doc. Approved By

M. Campbell

Doc. Issued

6/8/2011

Transmit #

Issued Rev



HP

7.50

Enclosure

TEFC

Locked Rotor

Amps

50

Model: Y754SDGC41A-P

kW

5.5

IP

56

Rotor wk²

Inertia

(lb-ft²)

1.15

Pole

4

Ins. Class


F


Full Load

(lb-ft)

22.3

		Issued Date	6/20/202	Transmit #		
		Issued By	dschoeck		Issued Rev	
SF	PEED TORQ	UE/CURREN	IT CURVE			
Т	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
	1770	213T	575	60	3	8.2
	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
	1.15	CONT	91.7	В		40 C
			Torque			
	Locked Rotor		Pull Up		Break Down	
	(%)		(%)		(%)	
	26	0	195		315	
	Des	sign Valu	es			

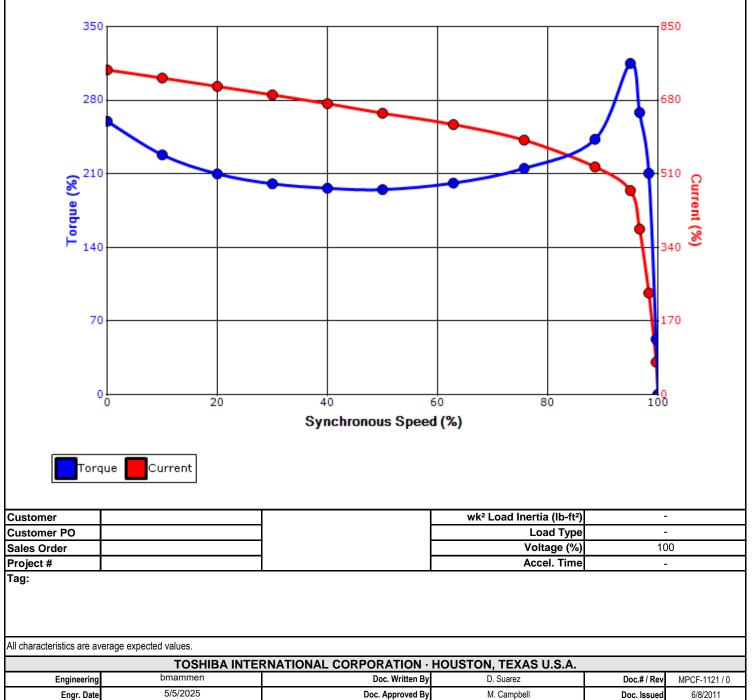

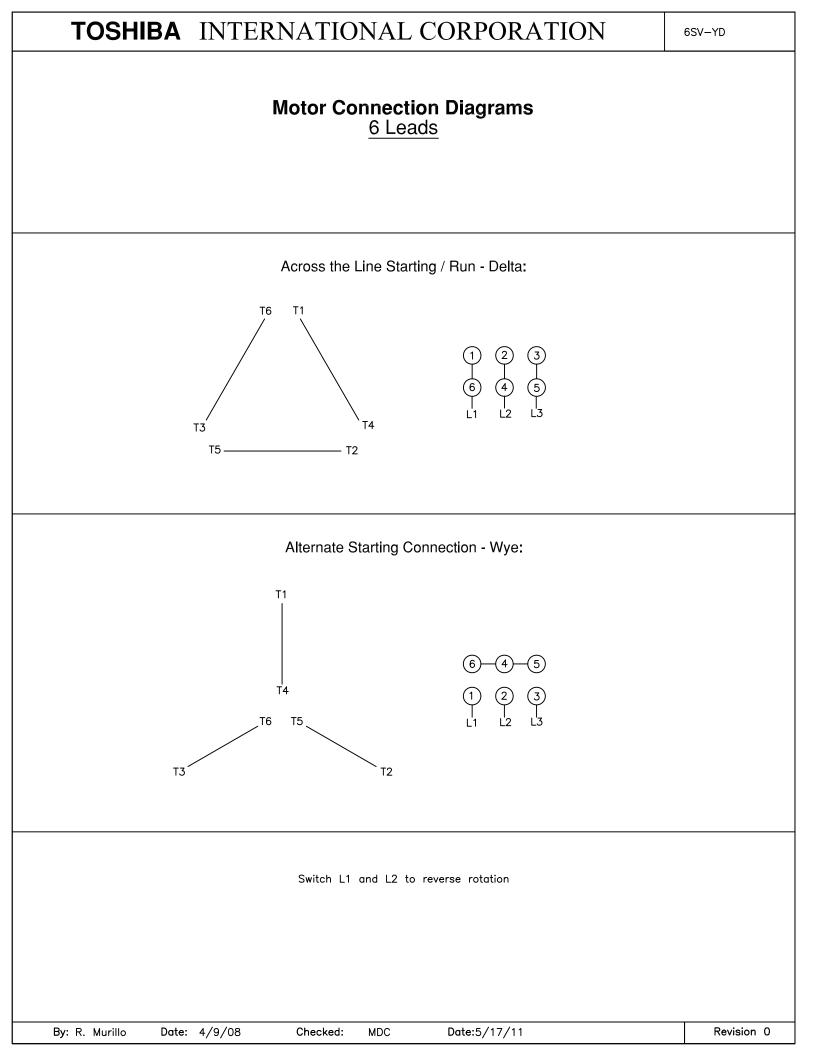

TOSH	IIRA			Issued Date: Issued By:	6/20/20 dschoe	-	Transmit #: Issued Rev:	
Leading Inr	••••••••••••••••••••••••••••••••••••••		SPAR	E PARTS LIS	Τ*			
HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	4	1770	213T	575	60	3	8.2
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	91.7	В		40 C
	•			-		-		
Bearings DE	6308ZZC3 / 4	0BC03JPP3OX						

*Bearings are the only recommended spare part(s).

Bearings NDE

Other than the grease used for regreasable bearings and the oil used for oil-lubricated bearings, Toshiba advises that there are no "use" parts. The only insurance spares that Toshiba suggests for these squirrel-cage induction motors are industry-standard and commercially available off-the-shelf bearings as noted above.

Motor components such as terminal boxes, fan covers and other machined parts are available on special request. In these cases, please advise our order entry department of the model and serial numbers found on the motor nameplate and a description of the needed components. With this information they will be able to furnish the current part number, price and availability.

Note: Our internal part numbers are subject to change without notice and are not published.

6308ZZC3 / 40BC03JPP3OX

Customer								
Customer PO								
Sales Order								
Project #								
Tag:								
All characteristics are average expected values.								
TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.								
Engineering	bmammen	Doc. Written By	D. Suarez	Doc.#/Rev	MPCF-1125 / 0			
Engr. Date	5/5/2025	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011			