



Issued Date	6/20/2025	Transmit #	
Issued By	dschoeck	Issued Rev	

TYPICAL MOTOR PERFORMANCE DATA

Model: Y754XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	4	1770	215TC	230/460	60	3	20.6/10.3
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	91.7	В		40 C

Load	HP	kW	Amperes	Efficiency (%)	Power Factor (%)
Full Load	7.50	5.6	10.3	91.8	74.6
¾ Load	5.62	4.2	8.4	90.5	68.8
½ Load	3.75	2.8	6.8	87.5	58.4
¼ Load	1.87	1.4	4.6	80.6	46.9
No Load			5.7		5.0
Locked Rotor			63		39.8

Torque							
Full Load	Locked Rotor	Pull Up	Break Down	Inertia			
(lb-ft)	(% FLT)	(% FLT)	(% FLT)	(lb-ft²)			
22.3	260	195	315	1.15			

Safe Stall	Time(s)	Sound	Bearin	une*	Approx. Motor Weight	
Cold	Hot	Pressure	Bearings*		Approx. Motor Weight	
Joid	1100	dB(A) @ 1M	DE	NDE	(lbs)	
35	15	-	6308UUC3	6308UUC3		

*Bearings are the only recommended spare part(s).

Motor Options: Product Family:EQP Global Explosion Proof Mounting:C-Face Round,Shaft:T Shaft

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.								
Engineering	bmammen	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 0			
Engr. Date	5/5/2025	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011			



Issued Date	6/20/2025	Transmit #	
Issued By	dschoeck	Issued Rev	

TYPICAL MOTOR PERFORMANCE DATA

Model: Y754XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	4	1450	215TC	190/380	50	3	22.8/11.4
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.0	CONT	90.5	В		40 C

Load	HP	kW	Amperes	Efficiency (%)	Power Factor (%)
Full Load	7.50	5.6	11.4	90.6	82.7
¾ Load	5.62	4.2	9.0	90.2	78.1
½ Load	3.75	2.8	7.0	88.2	68.4
4 Load	1.87	1.4	4.7	81.8	54.2
No Load			4.5		6.3
Locked Rotor			66		42.0

Torque							
Full Load	Locked Rotor	Pull Up	Break Down	Inertia			
(lb-ft)	(% FLT)	(% FLT)	(% FLT)	(lb-ft²)			
27.2	220	165	275	1.15			

Safe Stall	Time(s)	Sound	Bearin	une*	Approx. Motor Weight	
Cold	Hot	Pressure	Bearings*		Approx. Motor Weight	
Join	1100	dB(A) @ 1M	DE	NDE	(lbs)	
32	23	-	6308UUC3	6308UUC3		

*Bearings are the only recommended spare part(s).

Motor Options: Product Family:EQP Global Explosion Proof Mounting:C-Face Round,Shaft:T Shaft

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.						
Engineering	bmammen	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 0	
Engr. Date	5/5/2025	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011	




Issued Date	6/20/2025	Transmit #	
Issued By	dschoeck	Issued Rev	

SPEED TORQUE/CURRENT CURVE

Model: Y754XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	4	1770	215TC	230/460	60	3	20.6/10.3
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	91.7	В		40 C
Locked Rotor	Rotor wk ²				Torque			
Amps	Inertia	Full Load	Locked	Rotor	Pull Up)	Break	Down
Allips	(lb-ft²)	(lb-ft)	(%	b)	(%)		(%	6)
63	1.15	22.3	26	0	195		3′	15

Design Values

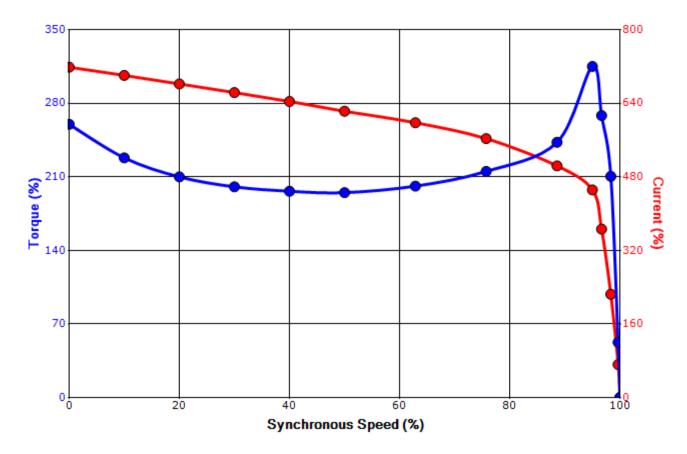

Torque	Current
--------	---------

Customer	wk² Load Inertia (Ib-f	2) -
Customer PO	Load Typ	е -
Sales Order	Voltage (%	6) 100
Project #	Accel. Tim	е -

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.						
Engineering	bmammen	Doc. Written By	D. Suarez	Doc.#/Rev	MPCF-1121 / 0	
Engr. Date	5/5/2025	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011	




Issued Date	6/20/2025	Transmit #	
Issued By	dschoeck	Issued Rev	

SPEED TORQUE/CURRENT CURVE

Model: Y754XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	4	1450	215TC	190/380	50	3	22.8/11.4
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.0	CONT	90.5	В		40 C
Looked Boton	Rotor wk ²				Torque			
Locked Rotor Amps	Inertia	Full Load	Locked	Rotor	Pull Up		Break	Down
Allips	(lb-ft²)	(lb-ft)	(%	b)	(%)		(%	%)
66	1.15	27.2	22	0	165		27	75

Design Values

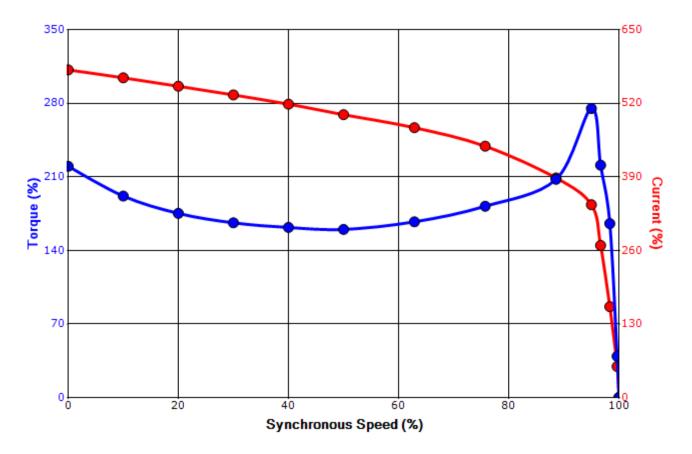



Customer	wk² Load Inertia (Ib-f	2) -
Customer PO	Load Typ	е -
Sales Order	Voltage (%	6) 100
Project #	Accel. Tim	е -

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.						
Engineering	bmammen	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1121 / 0	
Engr. Date	5/5/2025	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011	


Motor Connection Diagrams 12 Leads

Across-the-Line Starting / Running Connections

Low Voltage Delta



High Voltage Delta

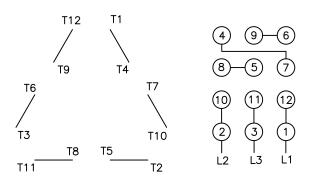

Switch L1 and L2 to reverse rotation

Suitable for Wye-Delta Starting and Limited Part-Winding-Starting. Please Contact Toshiba International for specific connections.

By: R. Murillo Date: 4/9/08 Checked: MDC Date: 5/17/11 Revision 1



Issued Date:	6/20/2025	Transmit #:	
Issued By:	dschoeck	Issued Rev:	

SPARE PARTS LIST*

Model: Y754XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	4	1770	215TC	230/460	60	3	20.6/10.3
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	91.7	В		40 C

 Bearings DE
 6308UUC3 / 40BC03JG3OX

 Bearings NDE
 6308UUC3 / 40BC03JG3OX

*Bearings are the only recommended spare part(s).

Other than the grease used for regreasable bearings and the oil used for oil-lubricated bearings, Toshiba advises that there are no "use" parts. The only insurance spares that Toshiba suggests for these squirrel-cage induction motors are industry-standard and commercially available off-the-shelf bearings as noted above.

Motor components such as terminal boxes, fan covers and other machined parts are available on special request. In these cases, please advise our order entry department of the model and serial numbers found on the motor nameplate and a description of the needed components. With this information they will be able to furnish the current part number, price and availability.

Note: Our internal part numbers are subject to change without notice and are not published.

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.										
Engineering	bmammen	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1125 / 0					
Engr. Date	5/5/2025	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011					